

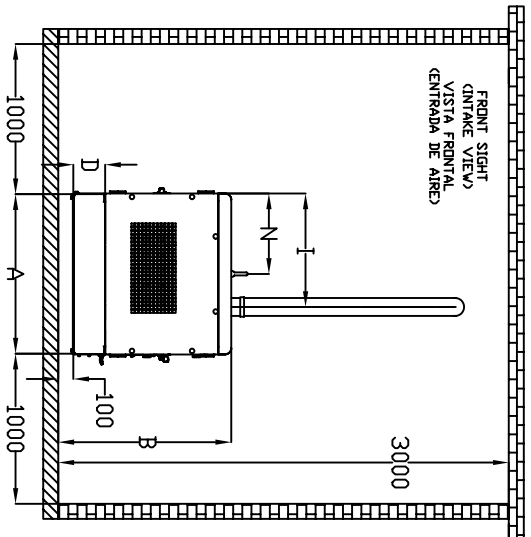


COOLING AIR INTAKE  
ENTRADA DE AIRE

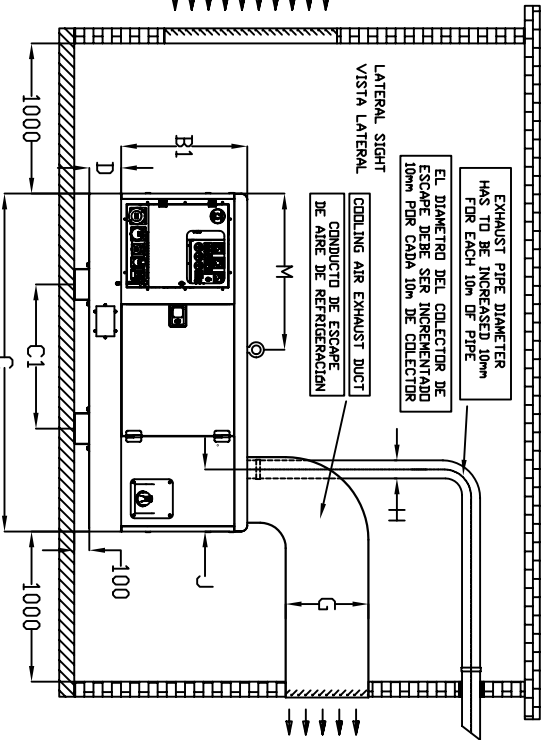

	GSL22D	GSL30D	GSL42D
A (mm)	1072	1072	1072
B (mm)	1152	1152	1152
B1 (mm)	840	840	840
C (mm)	2250	2250	2250
C1 (mm)	857	857	857
D (mm)	212	212	212
E (mm)	437	437	437
F (mm)	955	955	955
G (mm)	546	546	546
H (mm)	65	65	65
I (mm)	755	755	755
J (mm)	413,3	413,3	413,3
K (mm)	1194	1194	1194
L (mm)	875	875	875
M (mm)	1040	1040	1040
N (mm)	536	536	536
P (mm)	555	555	555

COOLING AIR INTAKE  
ENTRADA DE AIRE

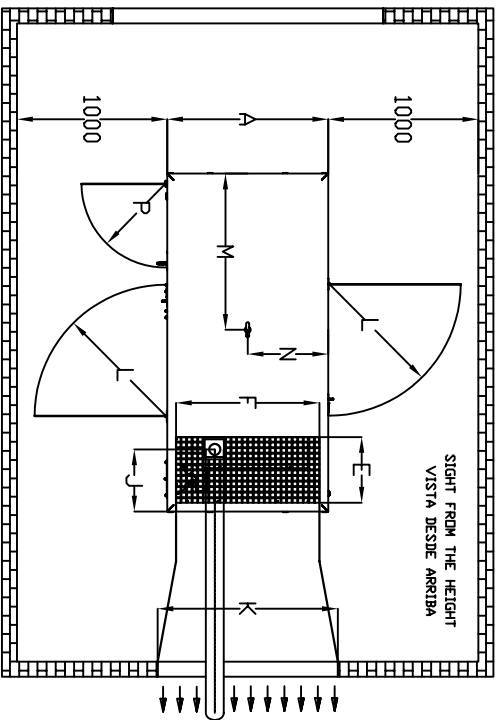

MODEL / MODELO	PRIME POWER / POTENCIA	ENGINE / MOTOR	ALTERNATOR / BCI	FUEL TANK (LIT) / DEPÓSITO DE COMBUSTIBLE	WEIGHT (KG) / PESO (KG)
GSL22D	20.0	F4M 2011	BCI 184E	120	912
GSL30D	29.0	F4M 2011	BCI 184F	120	992
GSL42D	39.3	F4M 2011	BCI 184J	120	1064

MODEL / MODELO	AIR FLOW / CAUDALES DE AIRE (M3/H)	FUEL CONSUMPTION / CONSUMO DE COMBUSTIBLE (L/H)
GSL22D	85.8	75% LOAD 31.4 100% LOAD 23.6
GSL30D	117	75% LOAD 31.4 100% LOAD 22.5
GSL42D	151	75% LOAD 31.4 100% LOAD 22.5

NOTE: GENERATING SET MUST BE LOCATED WITH, AT LEAST, ONE METER FREE SPACE AROUND FOR MAINTENANCE WORK SURFACE OF COOLING AIR INTAKE LOUVERS MUST BE, AT LEAST, TWICE SURFACE OF COOLING AIR EXHAUST LOUVERS

NOTA: EL GENERADOR DEBE SITUARSE CON, AL MENOS, UN METRO LIBRE ALREDEDOR PARA TRABAJOS DE MANTENIMIENTO LA SUPERFICIE DE REJILLA DE REFRIGERACION DE ENTRADA DEBE SER, AL MENOS, DOS VECES LA SUPERFICIE DE LA REJILLA DE SALIDA DE AIRE

\* IF IN DOUBT-ASK, DO NOT SCALE / EN CASO DE DUDA-PREGUNTAR, NO ESCALAR  
\* RECOMMENDED INSTALLATION DIMENSIONS FOR STANDARD CONFIGURATION / DIMENSIONES DE INSTALACION RECOMENDADAS PARA CONFIGURACION ESTANDAR  
\* THE PRODUCER RESERVES THE RIGHT OF MODIFYING THE DIMENSIONS REPRESENTED IN THIS PLANE WITHOUT PRIOR NOTICE  
\* EL FABRICANTE SE RESERVA EL DERECHO DE MODIFICAR LAS DIMENSIONES REPRESENTADAS EN ESTE PLANO SIN PREVIO AVISO

2004	DATE	NAME
Drawn		JGM
Checked		
Exocontracted		

RECOMMENDED INSTALLATION DIMENSIONS  
SOUNDPROOF GENSET



№ P[6S]22D-42D\_500

Replaced by:

GSL22D-30D-42D - 1500 RPM