
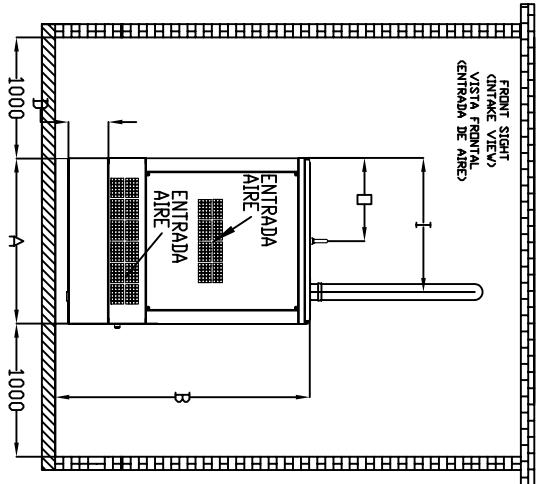


COOLING AIR INTAKE
ENTRADA DE AIRE

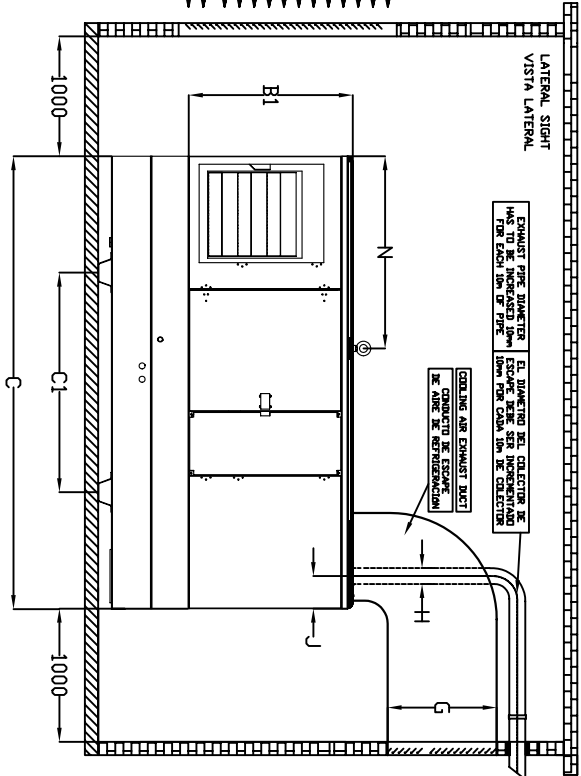


	GSW195D	GSW220D
A (mm)	1240	1240
B (mm)	1914	1914
B1 (mm)	1232	1232
C (mm)	3000	3000
C1 (mm)	1650	1650
D (mm)	300	300
E (mm)	594	594
F (mm)	1140	1140
G (mm)	928	928
H (mm)	160	160
I (mm)	1011	1011
J (mm)	245	245
K (mm)	1395	1395
L (mm)	915	915
M (mm)	739	739
N (mm)	1443	1443
O (mm)	625	625
P (mm)	474	474

MODEL /	FRIGTE POWER	ENGINE	ALTERNATOR	FUEL TANK (LIT)	WEIGHT (KG)
MODEL /	POTENCIA	MOTOR	ALTERNADOR	RESERVOIR DE COMBUSTIBLE	PESO (KG)
GSW195D	18KVA	BRM1013P2P2	UG274G	340	2700
GSW220D	207KVA	BRM1013P2P3	UG274H	340	2700

MODEL /	CONSUMPTION	COOLING AIR	EXHAUST GASES	FUEL CONSUMPTION	100% LOAD
MODEL /	COMBUSTION	AIRE DE REFRIGERACION	GASES DE ESCAPE	75% LOAD	100% LOAD
GSW195D	644	11160	1926	32.9	43.9
GSW220D	744	11160	2194	36.5	49.1

COOLING AIR INTAKE
ENTRADA DE AIRE

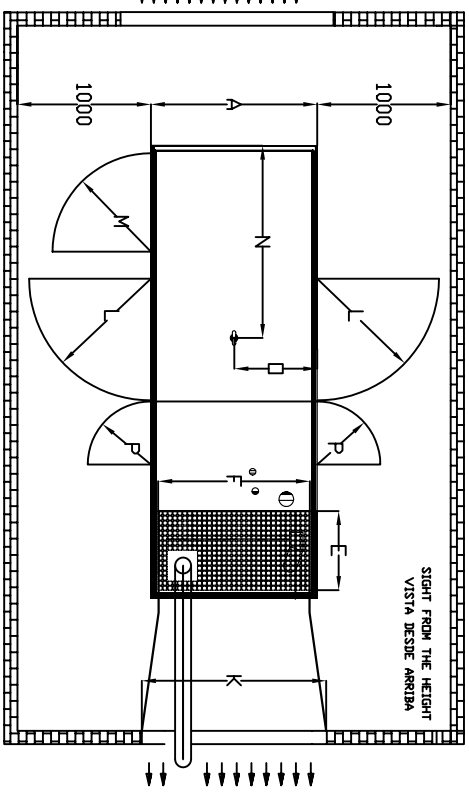

NOTE: GENERATING SET MUST BE LOCATED WITH, AT LEAST, ONE METER FREE SPACE AROUND FOR MAINTENANCE WORK. SURFACE OF COOLING AIR INTAKE LOUVERS MUST BE, AT LEAST, TWICE SURFACE OF COOLING AIR EXHAUST LOUVERS. NOTA: EL GENERADOR DEBE SITUARSE CON, AL MENOS, UN METRO LIBRE ALREDEDOR PARA TRABAJOS DE MANTENIMIENTO. LA SUPERFICIE DE REJILLA DE REFRIGERACION DE ENTRADA DEBE SER, AL MENOS, DOS VECES LA SUPERFICIE DE LA REJILLA DE SALIDA DE AIRE.

IF IN DOUBT-ASK, DO NOT SCALE / EN CASO DE DUDA-PREGUNTAR, NO ESCALAR. RECOMMENDED INSTALLATION DIMENSIONS FOR STANDARD CONFIGURATION / DIMENSIONES DE INSTALACION RECOMENDADAS PARA CONFIGURACION ESTANDAR. THE PRODUCER RESERVES THE RIGHT OF MODIFYING THE DIMENSIONS REPRESENTED IN THIS PLANE WITHOUT PRIOR NOTICE. EL FABRICANTE SE RESERVA EL DERECHO DE MODIFICAR LAS DIMENSIONES REPRESENTADAS EN ESTE PLANO SIN PREVIO AVISO.

2006	DATE	NAME
Dir. G.W.R.		
Checked	16-05-06	
Examined		

RECOMMENDED INSTALLATION DIMENSIONS
SOUNDPROOF GENSET
GSW195 - 220 D 1,500 RPM
Replaced by: P15W195-220D 300

